



Standard Detail & Specifications

Skimmer Dewatering Device

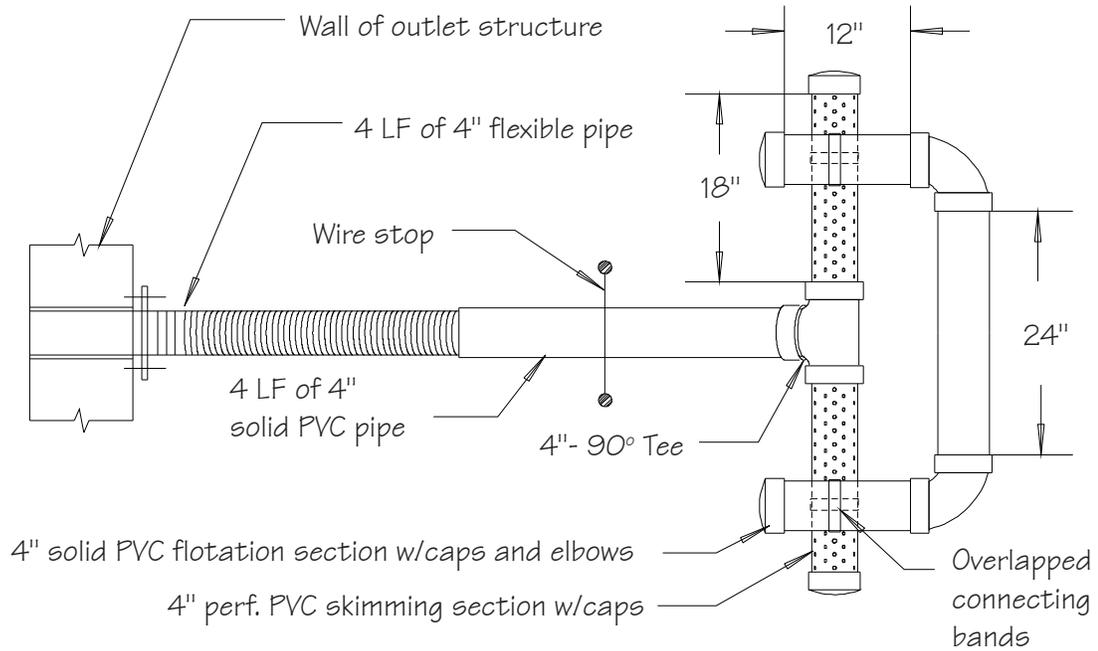

Plan

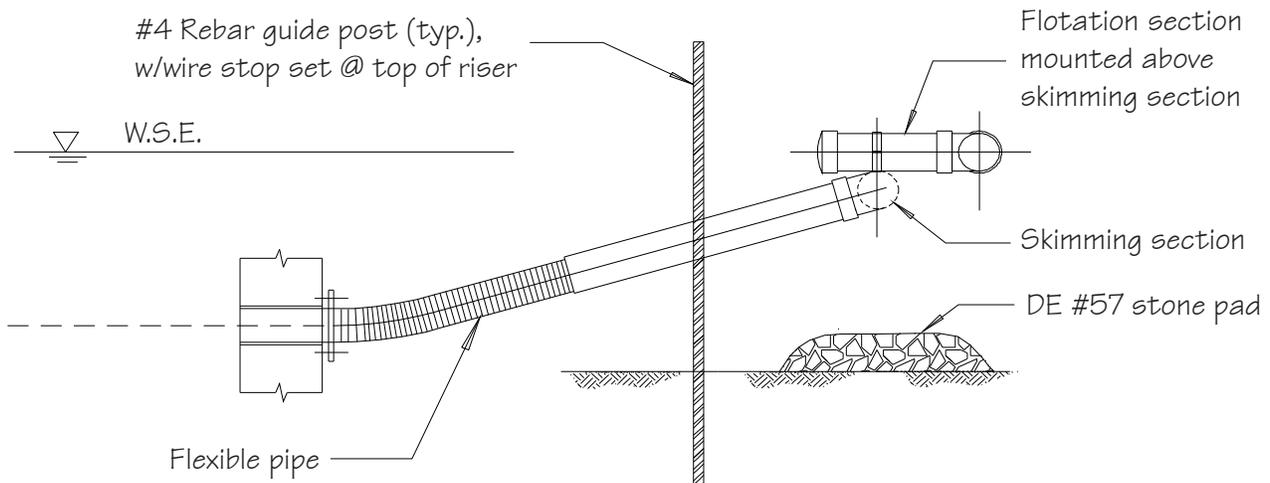

Profile thru $\frac{1}{2}$ of Pipe

Source:

Adapted from drawing by
Vandemark & Lynch, Inc.

Symbol:



Detail No.

DE-ESC-3.2.3.1

Sheet 1 of 2

Effective July 2023

Standard Detail & Specifications

Skimmer Dewatering Device

Construction Notes:

1. Pipe flotation section shall be solvent welded to ensure an airtight assembly. Contractor to conduct a test to check for leaks prior to installation.
2. Skimmer section shall have (12) rows of 1/2" dia. holes, 1-1/4" on center. If additional filtration is necessary, the filtering media shall consist of a Type GD-II geotextile fabric wrapped around the perforated portion of the skimmer and attached with plastic snap ties, bands, etc.
3. Flexible pipe shall be inserted into solid pipe and fastened with (2) #8 wood screws.
4. At a minimum, the structure shall be inspected after each rain and repairs made as needed. If vandalism is a problem, more frequent inspection may be necessary.
5. Construction operations shall be carried out in such a manner that erosion and water pollution are minimized.
6. The structure shall only be removed when the contributing drainage area has been properly stabilized.

Materials:

1. Solid pipe - 4" Sched. 40 PVC
2. Perforated pipe - 4" Sched. 40 PVC
3. 90° Tee (1 ea.) - 4" Sched. 40 PVC
4. 90° Elbow (2 ea.) - 4" Sched. 40 PVC
5. Cap (4 ea.) - 4" Sched. 40 PVC, solid
6. Flexible pipe - 4" corrugated plastic tubing (non-perforated)

Source:

Delaware ESC Handbook

Symbol:



Detail No.

DE-ESC-3.2.3.1

Sheet 2 of 2

Effective July 2023